


Hurley, Pat - 5/10/2019 - AC440 measurement

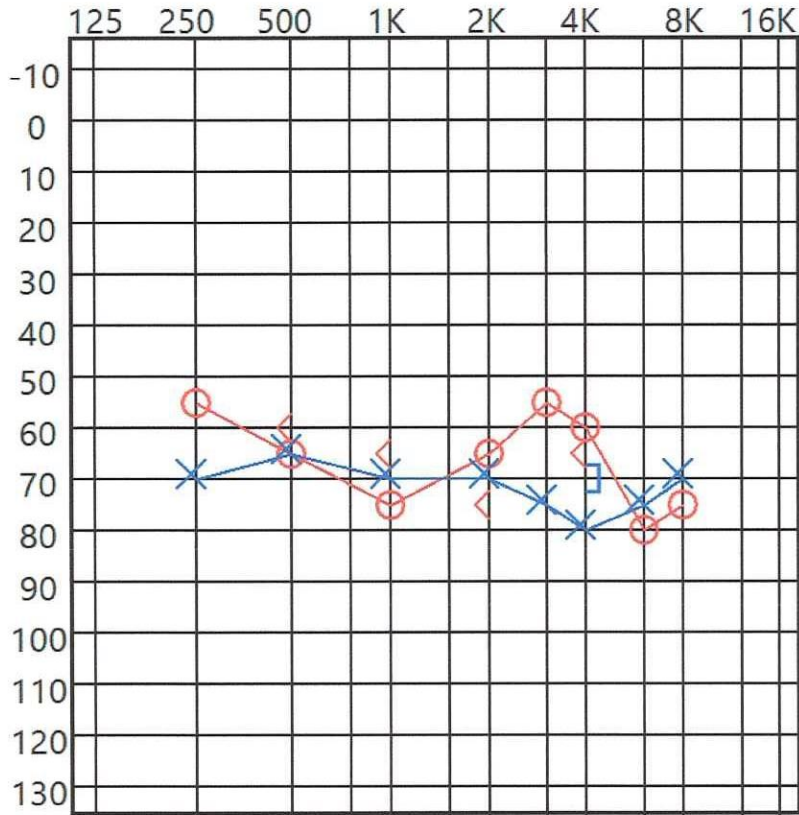

	R	L	B		R	L	B		R	L	B
AC Unmasked	○	×	∟	MCL	M	M	M	No Response	↘	↘	↓
AC Masked	△	□		UCL	U	U	U	Un-Measurable	↗	↗	
BC Unmasked	<	>	^					Free Field	F	F	F
BC Masked	┌	┐									
Soundfield	⊗	⊗	S								
Soundfield-Aided	A	A	A								

DEMOGRAPHICS

Name	Hurley, Pat	Provider	Nicole Anzalone
Visit Date	5/10/2019	Degree	Au.D.
DOB		Referral	

CONFIGURATION

Audiometer	Test Method
Calibration	Transducer
Reliability	Notes

SPEECH AUDIOMETRY

	SAT	SRT	Masking	MCL	UCL
Right		75			
Left		80			
Binaural					
Soundfield					
SF Aided					

WORD RECOGNITION

	Results			Results with Noise			
	dBHL	Mask	% Words	dBHL	Mask	% Words	
Right	90		28	25			
Right Aided							
Left	90		44	25			
Left Aided							
Soundfield							
SF Aided							

PTA

Freqs	Right	Left
2	70	68
3	68	68
4	66	71